


Mitsutomo Wiring Diagram

Indoor Unit: HW-UZ09-LA-Q

INDOOR WIRING DIAGRAM
16022000040253

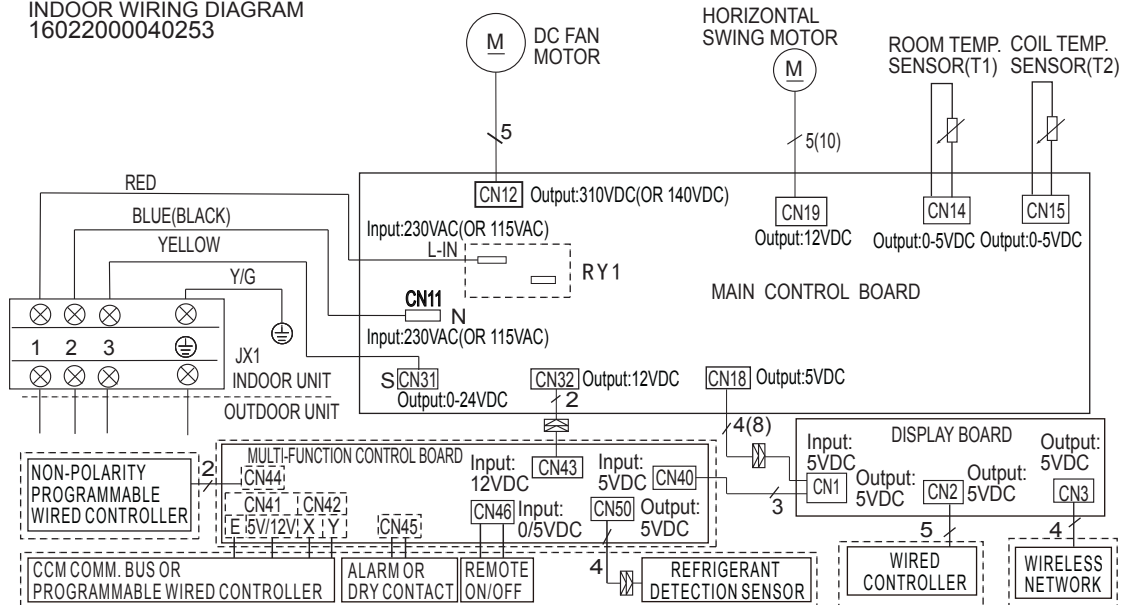

Note1: COMPONENT IN DASH LINE IS OPTIONAL OR FIELD WIRING.

Note2: The programmable wired controller and CCM COMM. BUS use the same port CN42 CN41

FOR SETTING NET ADDRESS (CCM Comm. Bus)

ENC3+F1 (MULTI-FUNCTION CONTROL BOARD)	0~F	0~F	0~F	0~F
CODE	0~F	0~F	0~F	0~F
NETADDRESS	0~15	16~31	32~47	48~63
FACTORY SETTING	✓			